



WASTE DISCHARGE PERMIT NO. SC-100022-FSA

Pursuant to:

Greater Vancouver Sewerage & Drainage District Sewer Use Bylaw No. 299, 2007 (as amended)
and the BC Environmental Management Act, S.B.C. 2003, c.53

Issued to:

Pepsico Beverages Canada Co.
(the "Permittee")

To Authorize:

the discharge of Wastewater to Sewer from
a soft drink and juice processing plant

Located at

747 Chester Road, Delta, BC V3M 6E7

Effective Period:

The terms and conditions set out in the Permit apply to the existing or planned works on
July 27, 2020

All previous versions of this Waste Discharge Permit are hereby rescinded and rendered null and void.

Issued: December 16, 1991
Amended: July 27, 2020


Grant McGillivray
Deputy Sewage Control Manager

SCHEDULE A

This Schedule sets out requirements for the quantity and quality of the discharge to Sewer.

1. AUTHORIZED RATE OF DISCHARGE

The Permittee shall not exceed the following:

Sample Point: 1

- Maximum daily discharge flow rate: **3000.00 m³/d**
- Maximum instantaneous peak flow rate: **33.50 L/s**

Sample Point: 2

- Maximum daily discharge flow rate: **600.00 m³/d**
- Maximum instantaneous peak flow rate: **10.00 L/s**

2. AUTHORIZED DISCHARGE CRITERIA

- a) The Permittee shall not discharge Restricted Waste or other Waste, as defined in the Bylaw, including but not limited to the following (regardless of sample type):

Parameter	Authorized Limit	Notes
pH	5.5 - 10.5 pH Units	
Total Suspended Solids	600 mg/L	
Oil & Grease Hydrocarbon	15 mg/L	

- b) The Permittee shall not discharge Restricted Waste or other Waste, as defined in the Bylaw, with the following exceptions (regardless of sample type):

Parameter	Authorized Limit	Notes
Biochemical Oxygen Demand	No Limit	
Chlorine (free)	15 mg/L	

- c) The Permittee shall not discharge Prohibited Waste, Storm Water or Uncontaminated Water, as defined in the bylaw.
- d) The Permittee shall not discharge Hazardous Waste, or effluent from the treatment of Hazardous Waste which exceeds the Effluent Standards for Hazardous Waste Facilities, as stipulated in Schedule 1.2, Column 3, of the BC Environmental Management Act Hazardous Waste Regulation.

Issued: December 16, 1991
 Amended: July 27, 2020


 Grant McGillivray
 Deputy Sewage Control Manager

Waste Discharge Permit No. SC-100022-FSA

GREATER VANCOUVER SEWERAGE & DRAINAGE DISTRICT

SCHEDULE B

This Schedule sets out requirements and locations for the approved sample points, waste sources, and works and procedures to treat and/or control the discharges to Sewer.

1. SAMPLE POINTS, WASTE SOURCES, WORKS & PROCEDURES

SAMPLE POINT: 1

This sample point is considered to be a point of discharge to Sewer. The approved sample point location is described and is illustrated in the photo(s) below.

Description: Final chamber of the trade waste interceptor located at the west side of the plant at the east end of the parking lot. Access is through a pipe opening directly connected to the final release pipe.

Source: Effluent from Production Lines 1-5 and Warehouse

- Filler lines
- Pasteurizer
- Can cooler
- Air compressor cooling water
- Juice room
- Boiler blowdown
- Production area washdown
- Warehouse trade waste/Product crushing activities
- Leachate from garbage compactors (including rain water collected from the uncovered sanitary drain by the outdoor compactors)

Type: Continuous

Works and Procedures	Completion Date
Collection system	Completed
Oil water separator	Completed
Trade waste interceptor	Completed
Equalization tank	Completed
Neutralization tanks	Completed
Continuous flow monitoring and recording	Completed
Continuous pH adjustment	Completed
Continuous pH monitoring and recording	Completed
Sodium hypochlorite injection on a flow proportional basis	Completed
Good operating practices	Completed

Issued: December 16, 1991
Amended: July 27, 2020


Grant McGillivray
Deputy Sewage Control Manager

Waste Discharge Permit No. SC-10022-FSA

SCHEDULE B

Photograph of Sample Point 1:



Issued: December 16, 1991
Amended: July 27, 2020


Grant McGillivray
Deputy Sewage Control Manager

Waste Discharge Permit No. SC-100022-FSA

SCHEDULE B

SAMPLE POINT: 2

This sample point is considered to be a point of discharge to Sewer. The approved sample point location is described and is illustrated in the photo(s) below.

Description: Final chamber of the trade waste interceptor in front of the first bay of the fleet maintenance shop. Access is through the northernmost manhole.

Source: Fleet Maintenance Area

- Effluent from fleet washing

Type: Continuous

Works and Procedures	Completion Date
Trade waste interceptor	Completed
Good operating practices	Completed


Issued: December 16, 1991
Amended: July 27, 2020


Grant McGillivray
Deputy Sewage Control Manager

Waste Discharge Permit No. SC-100022-FSA

SCHEDULE B

Photograph of Sample Point 2:

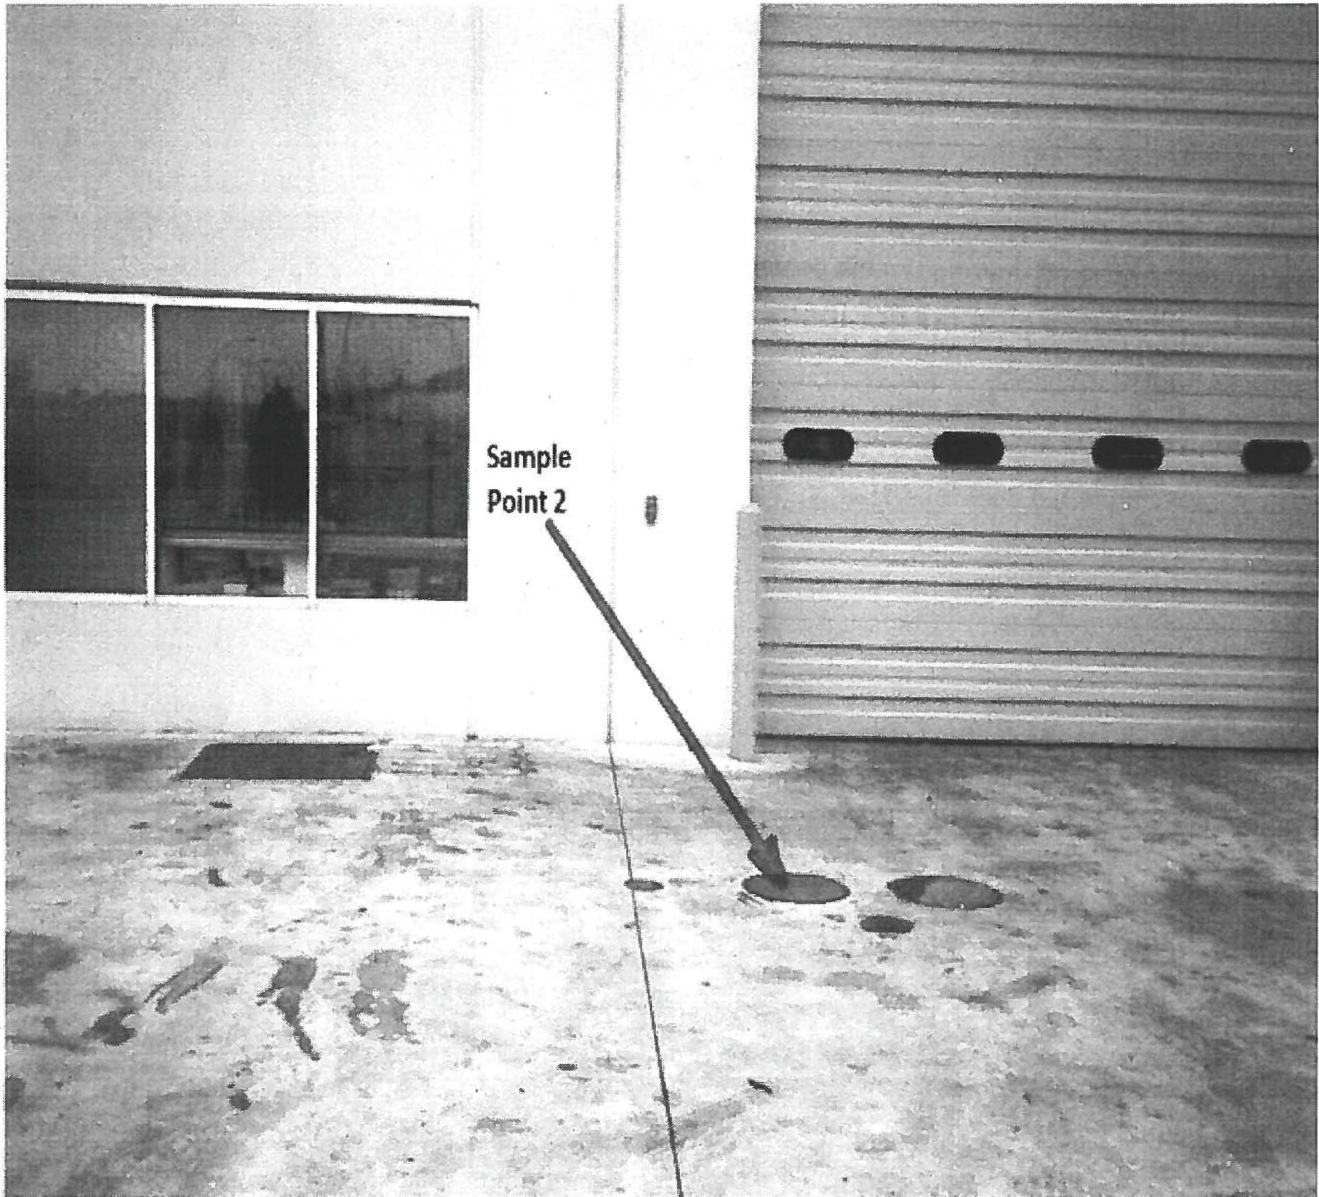


Issued: December 16, 1991
Amended: July 27, 2020


Grant McGillivray
Deputy Sewage Control Manager

Waste Discharge Permit No. SC-100022-FSA

SCHEDULE B

2. SITE PLAN(S)

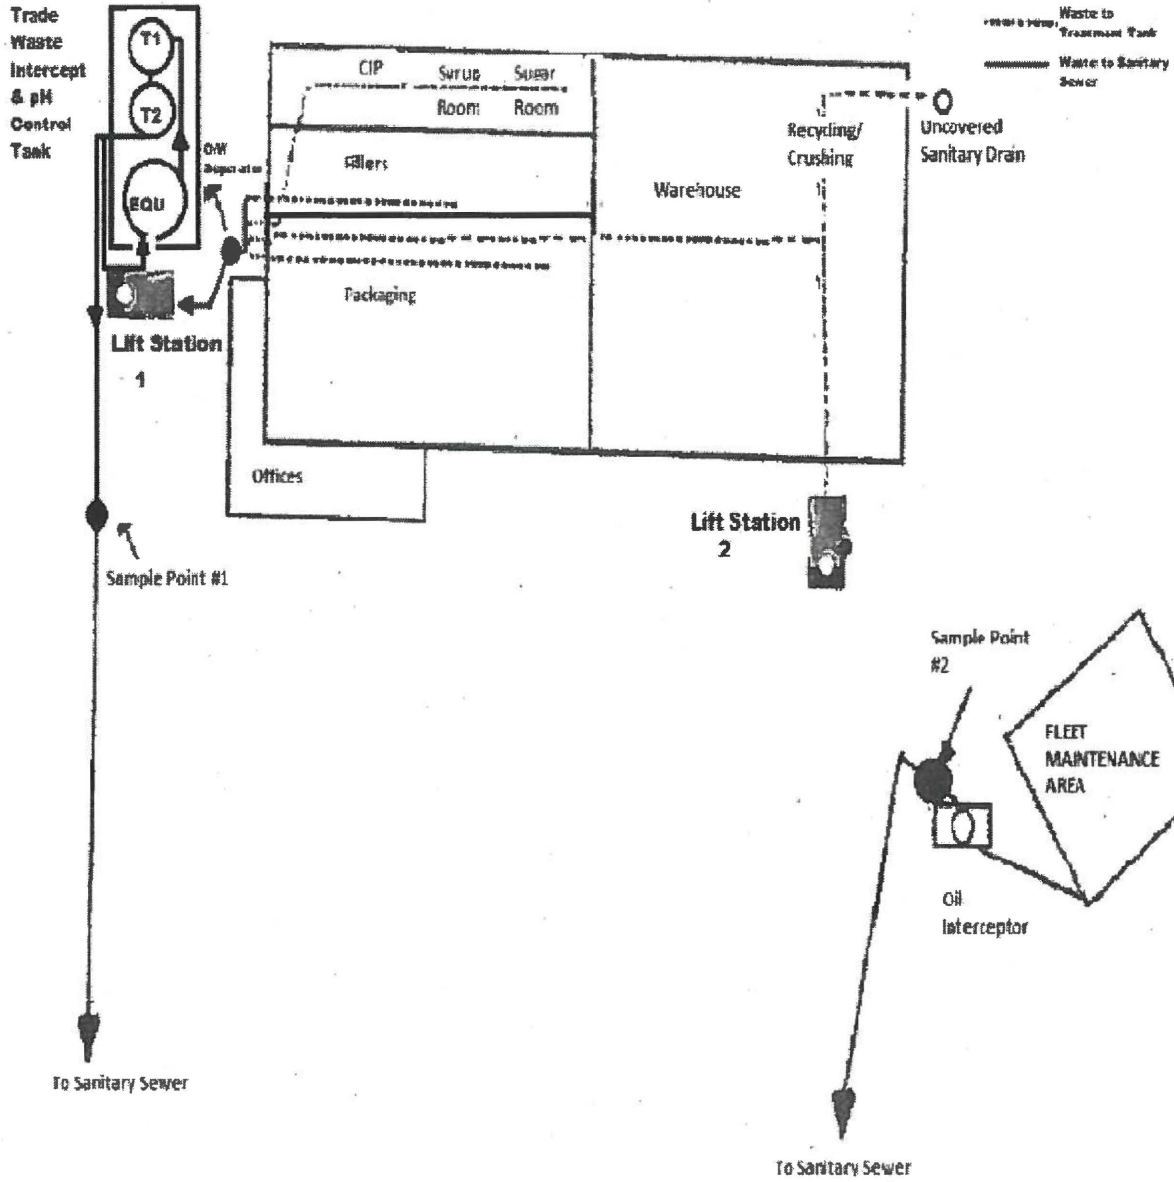

Issued: December 16, 1991
Amended: July 27, 2020


Grant McGillivray
Deputy Sewage Control Manager

Waste Discharge Permit No. SC-100022-FSA

SCHEDULE C

This Schedule sets out standard conditions and requirements for emergency procedures.

1. STANDARD CONDITIONS

- a) Except as otherwise provided in this Permit, all terms, conditions and definitions stipulated in the Bylaw shall apply to this Permit.
- b) Pursuant to the Bylaw, the Sewage Control Manager (the Manager) may amend the terms and conditions of this Permit.
- c) All records required by this permit shall be kept available for a minimum period of one year.

2. WORKS AND PROCEDURES

- a) All authorized works, procedures and requirements shall be employed at all times during any discharge to sewer. As applicable, all such works shall be inspected and calibrated regularly and maintained in good working condition.
- b) The Manager may require that additional works be installed if the existing works do not provide an acceptable level of treatment. The Manager must authorize new works or alterations to existing works. The Manager must authorize new waste sources.

3. NOTIFICATION PROCEDURES

The Permittee shall immediately report to Metro Vancouver at 604-643-8488 (24 hours):

- a) Spills with the potential to be discharged to the Sanitary Sewer.
- b) Failure of authorized works or conditions and/or failure to carry out authorized procedures that will or have the potential to result in a Permit limit being exceeded.
- c) Discharge pH less than 2 or greater than 12.5.


4. BY-PASSES

The discharge of Wastes that by-pass any authorized works or is not in accordance with procedures designated by the Permit is prohibited, unless prior authorization of the Manager is obtained.

5. DISCHARGE MONITORING

- a) All sampling and sample handling of wastewater discharges, including sample containers, storage, preservation and hold time requirements shall be carried out in accordance with all prescribed requirements stated within the latest edition of the "British Columbia Environmental Laboratory Manual" published by the Ministry of Environment, Province of British Columbia or "Standard Methods for the Examination of Water and Wastewater" published by the American Public Health Association, or an alternate standard authorized by the Manager.
- b) With the exception of pH and free chlorine measurements, all samples shall be analyzed by an independent, ISO/IEC 17025:2005 accredited laboratory unless otherwise authorized by the Manager.

Issued: December 16, 1991
Amended: July 27, 2020



Grant McGillivray
Deputy Sewage Control Manager

Waste Discharge Permit No. SC-100022-FSA

SCHEDULE C

- c) Laboratories used by the Permittee must also be accredited by the Canadian Association for Laboratory Accreditation and/or the Standards Council of Canada for all parameters analyzed and must participate in relevant proficiency testing programs for each parameter.
- d) Any changes in method or location of monitoring must be authorized by the Manager.
- e) Additional monitoring and/or reporting shall be undertaken by the Permittee when required by the Manager.

Issued: December 16, 1991
Amended: July 27, 2020


Grant McGillivray
Deputy Sewage Control Manager

Waste Discharge Permit No. SC-100022-FSA

SCHEDULE D

This Schedule sets out the requirements for the monitoring of the discharge to Sewer.

DISCHARGE SAMPLING AND ANALYSES

1. FLOW MEASUREMENTS

The Permittee shall measure or estimate the discharge flow to sanitary sewer during each month of operation using the method(s) authorized in Schedule B and record for reporting purposes the following:

- Total discharge volume (m³) for the month for sample point(s) 1, 2
- Number of days of discharge to sewer during the month for sample point(s) 1, 2
- Maximum daily discharge flow rate (m³/d) during the month for sample point(s) 1, 2

2. CONTINUOUS MEASUREMENTS

The Permittee shall continuously measure the discharge pH during the period of discharge to sewer for sample point(s) 1 and record for reporting purposes the following:

- The total number of hours of discharge below the authorized pH range and the total number of hours of discharge above the authorized pH range during each month of operation.
- Total number of hours of discharge during the month.

3. SAMPLING PROGRAM

Continuous Discharge Sampling:

The Permittee shall record for reporting purposes for each sample the following:

- Sample date
- Sample collection time or sample collection start and stop time(s) if applicable
- Total daily discharge volume (m³) on the date of sampling

SAMPLE POINT: 1

Continuous Discharges:

On one normal operating day once per month collect 1 set of composite samples and analyze for:

- Biochemical Oxygen Demand
- Total Suspended Solids

Issued: December 16, 1991
Amended: July 27, 2020


Grant McGillivray

Deputy Sewage Control Manager

Waste Discharge Permit No. SC-100022-FSA

SCHEDULE D

On each normal operating day collect 1 set of grab samples and analyze for:

- Chlorine (free)

SAMPLE POINT: 2

Continuous Discharges:

On one normal operating day once per quarter collect 1 set of grab samples and analyze for:

- pH
- Total Suspended Solids
- Oil & Grease Hydrocarbon

Grab sample pH analysis must be conducted immediately upon sampling.

Unless otherwise specified, composite samples shall consist of equal portions of grab samples, collected at a frequency of at least one per hour during discharge to sewer.

If composite sampling is specified, grab samples shall be taken during the period of composite sampling unless noted otherwise in this Schedule.

Unless otherwise specified, all samples should be taken during normal operations.

Issued: December 16, 1991
Amended: July 27, 2020


Grant McGillivray
Deputy Sewage Control Manager

Waste Discharge Permit No. SC-100022-FSA

SCHEDULE E

This Schedule sets out reporting requirements for this Permit.

1. REPORTING REQUIREMENTS

By July 31, 2020 and quarterly thereafter for the term of this permit:

The Permittee shall submit a report detailing the results of the discharge sampling and analyses program, as specified, for the previous calendar quarter including lab reports. This information shall be submitted electronically using the supplied password-enabled web based application.

Should a violation of any term or condition of the Permit be noted, the report shall include a summary of the investigation into the cause of the violation and the corrective actions taken or proposed to prevent future violations. This does not preclude the immediate notification requirements specified in Schedule C.

Issued: December 16, 1991
Amended: July 27, 2020


Grant McGillivray
Deputy Sewage Control Manager

Waste Discharge Permit No. SC-100022-FSA