



metrovancover

Greater Vancouver Regional District • Greater Vancouver Water District

Greater Vancouver Sewerage and Drainage District • Metro Vancouver Housing Corporation

4330 Kingsway, Burnaby, BC, Canada V5H 4G8 604-432-6200 www.metrovancover.org

*Policy & Planning Department
Tel. 604-432-6200 Fax 604-436-6707*

WASTE DISCHARGE PERMIT
No. SC-100030-NSSA
(the "Permit")

Under the provisions of the
Greater Vancouver Sewerage & Drainage District Sewer Use Bylaw No. 299, 2007 (as amended)
(the "Bylaw")

The Corporation of the District of North Vancouver
(the "Permittee")

is authorized to discharge Wastewater to Sewer from
a closed sanitary landfill located at

900 block Premier Street, North Vancouver, BC

This Permit has been issued under the terms and conditions prescribed in the attached
Schedules A, B, C, D and E for discharge services and works existing or planned on

July 01, 2011

Issued: March 06, 1992
Amended: June 28, 2011


Grant McGillivray
Deputy Sewage Control Manager

GREATER VANCOUVER SEWERAGE & DRAINAGE DISTRICT

SCHEDULE A

This Schedule sets out requirements for the quantity and quality of the discharge to Sewer.

1. AUTHORIZED RATE OF DISCHARGE

The Permittee shall not exceed the following:

Sample Point: 1

- Maximum daily discharge flow rate: **2300.00 m³/day**
- Maximum instantaneous peak flow rate: **25.77 L/second**

Sample Point: 2

- Maximum daily discharge flow rate: **2100.00 m³/day**
- Maximum instantaneous peak flow rate: **22.24 L/second**

2. AUTHORIZED DISCHARGE CRITERIA

- a) The Permittee shall not discharge Restricted Waste or other Waste, as defined in the Bylaw, including but not limited to the following (regardless of sample type):

| Parameter | Authorized Limit | Notes |
|------------------------|---------------------|-------|
| pH | 5.5 - 10.5 pH Units | |
| Total Suspended Solids | 600 mg/L | |
| Sulphide | 1 mg/L | |
| Phenols | 1 mg/L | |
| Aluminum - total | 50 mg/L | |
| Arsenic - total | 1 mg/L | |
| Boron - total | 50 mg/L | |
| Cadmium - total | 0.2 mg/L | |
| Chromium - total | 4 mg/L | |
| Cobalt - total | 5 mg/L | |
| Copper - total | 2 mg/L | |
| Lead - total | 1 mg/L | |
| Manganese - total | 5 mg/L | |
| Molybdenum - total | 1 mg/L | |
| Nickel - total | 2 mg/L | |
| Selenium - total | 1 mg/L | |
| Silver - total | 1 mg/L | |
| Zinc - total | 3 mg/L | |

Issued: March 06, 1992
Amended: June 28, 2011
Waste Discharge Permit No. SC-100030-NSSA


Grant McGillivray
Deputy Sewage Control Manager

GREATER VANCOUVER SEWERAGE & DRAINAGE DISTRICT


SCHEDULE A

- b) The Permittee shall not discharge Restricted Waste or other Waste, as defined in the Bylaw, with the following exceptions (regardless of sample type):

| Parameter | Authorized Limit | Notes |
|---------------------------|-------------------------|--------------|
| Biochemical Oxygen Demand | No Limit | |
| Ammonia as N | 60 mg/L | |
| Iron - total | 65 mg/L | |

- c) The Permittee shall not discharge Prohibited Waste, Storm Water or Uncontaminated Water, as defined in the bylaw with the exception of surface waters collected as part of the normal operation of the landfill until such time the British Columbia Ministry of Environment permits the District of North Vancouver to discharge the collected surface water to Lynn Creek.
- d) The Permittee shall not discharge Hazardous Waste, or effluent from the treatment of Hazardous Waste which exceeds the Effluent Standards for Hazardous Waste Facilities, as stipulated in Schedule 1.2, Column 3, of the BC Environmental Management Act Hazardous Waste Regulation.

Issued: March 06, 1992
Amended: June 28, 2011
Waste Discharge Permit No. SC-100030-NSSA


Grant McGillivray
Deputy Sewage Control Manager

GREATER VANCOUVER SEWERAGE & DRAINAGE DISTRICT

SCHEDULE B

This Schedule sets out requirements and locations for the approved sample points, waste sources, and works and procedures to treat and/or control the discharges to Sewer.

1. SAMPLE POINTS, WASTE SOURCES, WORKS & PROCEDURES

SAMPLE POINT: 1

This sample point is considered to be a point of discharge to Sewer. The approved sample point location is described and is illustrated in the photo(s) below.


Description: The wet well from leachate pump station #15 located at the north end of St. Denis Avenue along Lynn Creek.

Source: Sanitary Landfill - South End

Type: Continuous


| Works and Procedures | Completion Date |
|-----------------------------|------------------------|
| Leachate collection pipe | Completed |
| Good operating practices | Completed |

Issued: March 06, 1992
Amended: June 28, 2011
Waste Discharge Permit No. SC-100030-NSSA


Grant McGillivray
Deputy Sewage Control Manager

SCHEDULE B

Photograph of Sample Point 1:

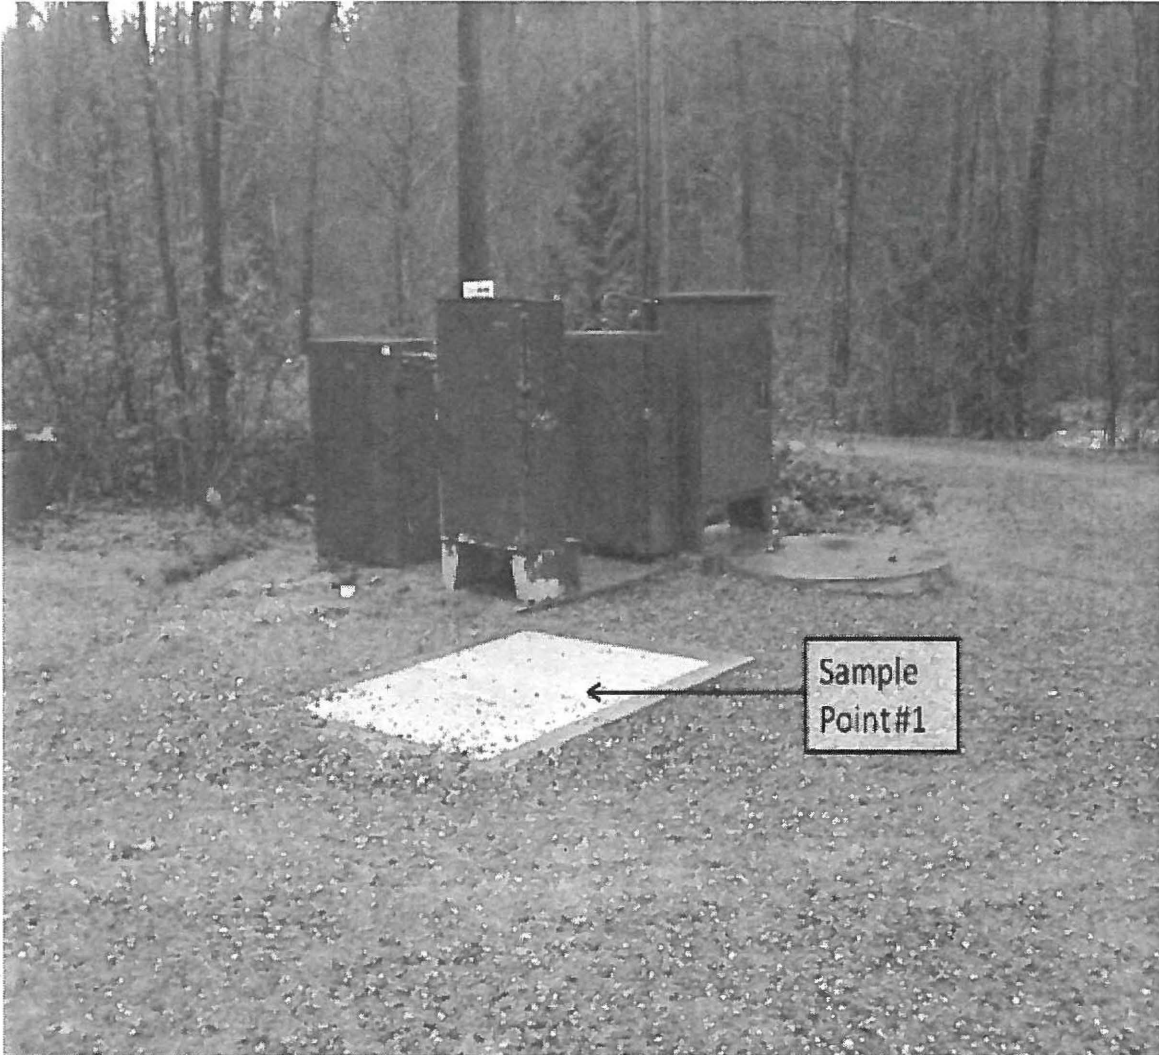

Issued: March 06, 1992
Amended: June 28, 2011
Waste Discharge Permit No. SC-100030-NSSA


Grant McGillivray
Deputy Sewage Control Manager

GREATER VANCOUVER SEWERAGE & DRAINAGE DISTRICT

SCHEDULE B

SAMPLE POINT: 2

This sample point is considered to be a point of discharge to Sewer. The approved sample point location is described and is illustrated in the photo(s) below.

Description: The wet well from leachate pump #18 located at the north end of the original landfill site approximately 1 km north of Sample Point #1.

Source: Sanitary Landfill - North End

Type: Continuous

| Works and Procedures | Completion Date |
|-----------------------------|------------------------|
| Leachate collection pipe | Completed |
| Good operating practices | Completed |

Issued: March 06, 1992
Amended: June 28, 2011
Waste Discharge Permit No. SC-100030-NSSA


Grant McGillivray
Deputy Sewage Control Manager

SCHEDULE B

Photograph of Sample Point 2:




Issued: March 06, 1992
Amended: June 28, 2011
Waste Discharge Permit No. SC-100030-NSSA


Grant McGillivray
Deputy Sewage Control Manager


GREATER VANCOUVER SEWERAGE & DRAINAGE DISTRICT

SCHEDULE B

2. SITE PLAN(S)

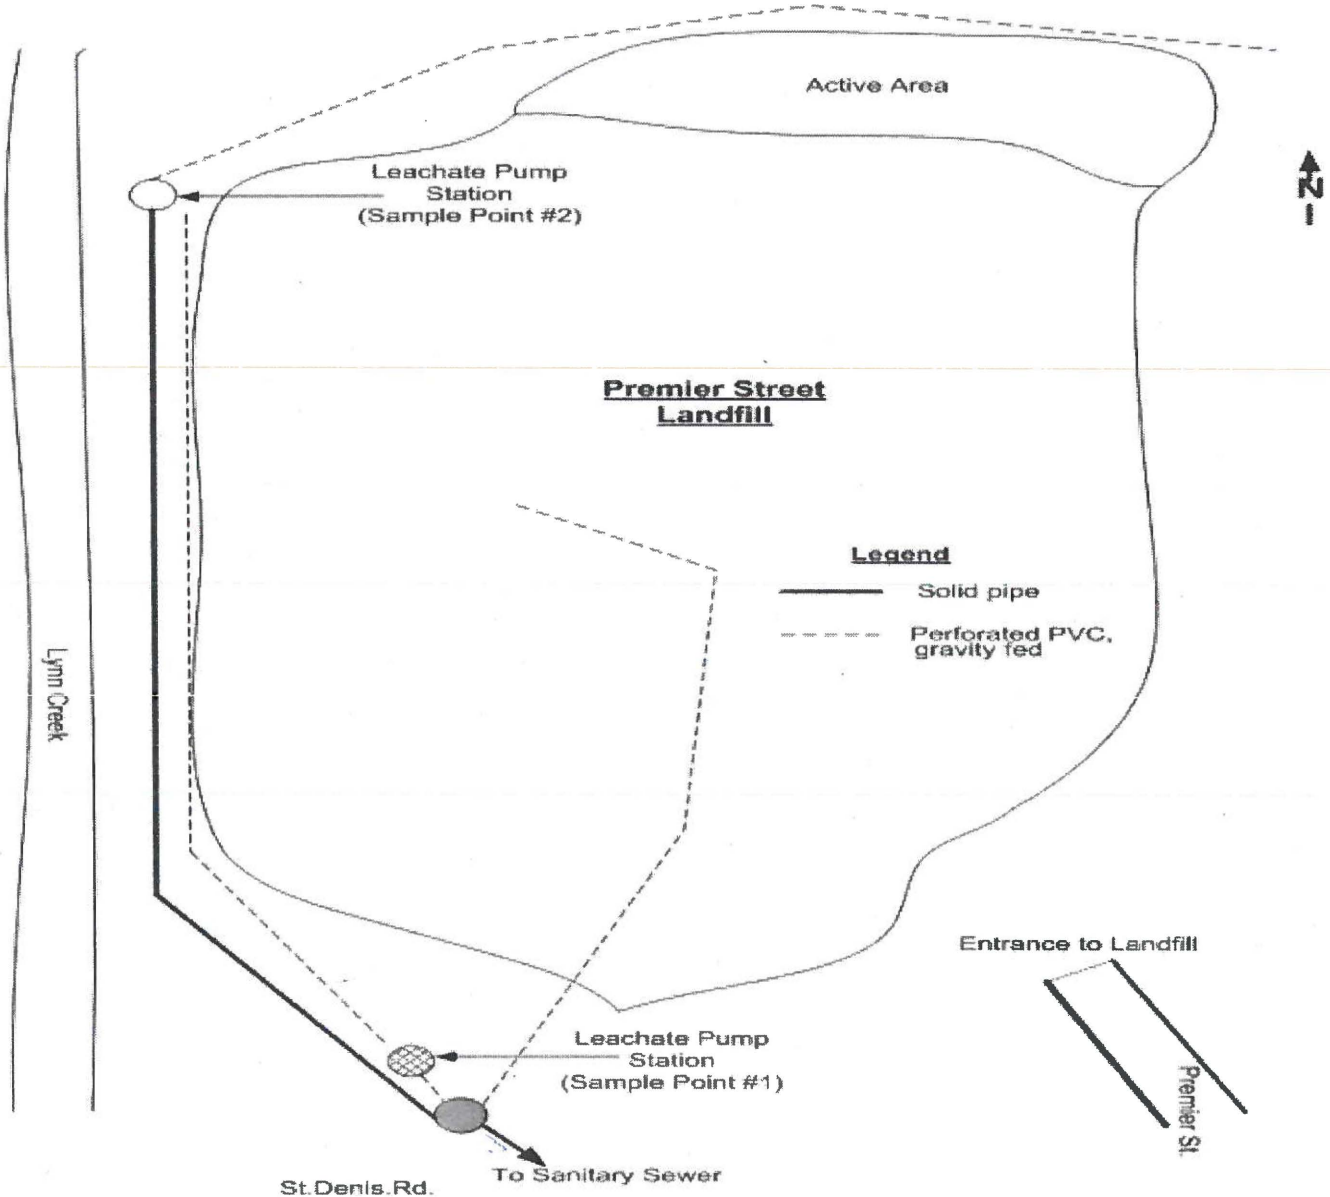

Issued: March 06, 1992
Amended: June 28, 2011
Waste Discharge Permit No. SC-100030-NSSA


Grant McGillivray
Deputy Sewage Control Manager

SCHEDULE C

This Schedule sets out standard conditions and requirements for emergency procedures.

1. STANDARD CONDITIONS

- a) Except as otherwise provided in this Permit, all terms, conditions and definitions stipulated in the Bylaw shall apply to this Permit.
- b) Pursuant to the Bylaw, the Sewage Control Manager (the Manager) may amend the terms and conditions of this Permit.
- c) All records required by this permit shall be kept available for a minimum period of one year.

2. WORKS AND PROCEDURES

- a) All authorized works, procedures and requirements shall be employed at all times during any discharge to sewer. As applicable, all such works shall be inspected and calibrated regularly and maintained in good working condition.
- b) The Manager may require that additional works be installed if the existing works do not provide an acceptable level of treatment. The Manager must authorize new works or alterations to existing works. The Manager must authorize new waste sources.

3. NOTIFICATION PROCEDURES

The Permittee shall immediately report to Metro Vancouver at 604-643-8488 (24 hours):

- a) Spills with the potential to be discharged to the Sanitary Sewer.
- b) Failure of authorized works or conditions and/or failure to carry out authorized procedures that will or have the potential to result in a Permit limit being exceeded.
- c) Discharge pH less than 2 or greater than 12.5.

4. BY-PASSES

The discharge of Wastes that by-pass any authorized works or is not in accordance with procedures designated by the Permit is prohibited, unless prior authorization of the Manager is obtained.

5. DISCHARGE MONITORING

- a) All sampling, measurements, tests and analyses of waste discharges shall be carried out in accordance with the latest edition of "Standard Methods for the Examination of Water and Wastewater" published by the American Public Health Association, or an alternate method authorized by the Manager. With the exception of pH measurements, all samples shall be analyzed by an independent laboratory unless otherwise authorized by the Manager.
- b) Laboratories used by the Permittee must be accredited by the Canadian Association for Laboratory Accreditation.
- c) Any changes in method or location of monitoring must be authorized by the Manager.
- d) Additional monitoring and/or reporting shall be undertaken by the Permittee when required by the Manager.

Issued: March 06, 1992
Amended: June 28, 2011
Waste Discharge Permit No. SC-100030-NSSA


Grant McGillivray
Deputy Sewage Control Manager

SCHEDULE D

This Schedule sets out the requirements for the monitoring of the discharge to Sewer.

DISCHARGE SAMPLING AND ANALYSES: Effective July 01, 2011

1. FLOW MEASUREMENTS

The Permittee shall measure or estimate the discharge flow to sanitary sewer during each month of operation using the approved method(s) and record for reporting purposes the following:

- Total discharge volume (m³) for the month for sample point(s) 1, 2
- Number of days of discharge to sewer during the month for sample point(s) 1, 2
- Maximum daily discharge flow rate (m³/day) during the month for sample point(s) 1, 2

2. SAMPLING PROGRAM

Continuous Discharge Sampling:

The Permittee shall record for reporting purposes for each sample the following:

- Sample date
- Sample collection time or sample collection start and stop time(s) if applicable
- Total daily discharge volume (m³) on the date of sampling

SAMPLE POINT: 1

Continuous Discharges:

On one normal operating day once per quarter collect 1 set of grab samples and analyze for:

- pH
- Biochemical Oxygen Demand
- Total Suspended Solids
- Ammonia as N
- Sulphide
- Phenols
- Total Metals by ICP Scan including:
Aluminum, Arsenic, Boron, Cadmium, Chromium, Cobalt, Copper, Iron, Lead, Manganese, Molybdenum, Nickel, Selenium, Silver, Zinc

Issued: March 06, 1992
Amended: June 28, 2011
Waste Discharge Permit No. SC-100030-NSSA


Grant McGillivray
Deputy Sewage Control Manager

SCHEDULE D

SAMPLE POINT: 2

Continuous Discharges:

On one normal operating day once per quarter collect 1 set of grab samples and analyze for:


- pH
- Biochemical Oxygen Demand
- Total Suspended Solids
- Ammonia as N
- Sulphide
- Phenols
- Total Metals by ICP Scan including:
Aluminum, Arsenic, Boron, Cadmium, Chromium, Cobalt, Copper, Iron, Lead,
Manganese, Molybdenum, Nickel, Selenium, Silver, Zinc

Grab sample pH analysis must be conducted immediately upon sampling.

If composite sampling is specified, grab samples shall be taken during the period of composite sampling unless noted otherwise in this Schedule.

Unless otherwise specified, all samples should be taken during normal operations.

Issued: March 06, 1992
Amended: June 28, 2011
Waste Discharge Permit No. SC-100030-NSSA


Grant McGillivray
Deputy Sewage Control Manager

GREATER VANCOUVER SEWERAGE & DRAINAGE DISTRICT

SCHEDULE E

This Schedule sets out reporting requirements for this Permit.

1. REPORTING REQUIREMENTS

By October 31, 2011 and quarterly thereafter for the term of this permit:

The Permittee shall submit a report detailing the results of the discharge sampling and analyses program, as specified, for the previous calendar quarter including lab reports.

Should a violation of any term or condition of the Permit be noted, the report shall include a summary of the investigation into the cause of the violation and the corrective actions taken or proposed to prevent future violations. This does not preclude the immediate notification requirements specified in Schedule C.

2. ADDITIONAL REPORTING

| Report Type | Requirements | Due Date | Frequency |
|--------------------|--|-----------------|------------------|
| Other | The Permittee shall submit a written advisory of scheduled leachate collection system cleaning activities at least 30 days prior to such activities. | N/A | N/A |

Issued: March 06, 1992
Amended: June 28, 2011
Waste Discharge Permit No. SC-100030-NSSA


Grant McGilivray
Deputy Sewage Control Manager