



WASTE DISCHARGE PERMIT NO. SC-101031-FSA

Pursuant to:

Greater Vancouver Sewerage & Drainage District Sewer Use Bylaw No. 299, 2007, as amended (the "Bylaw")
and the BC Environmental Management Act, S.B.C. 2003, c.53

Issued to:

Rosewood Holding Ltd.
(the "Permittee")

To Authorize:

the discharge of Wastewater to Sewer from
a fish processing operation

Located at


3133 188 Street, Surrey, BC V3Z 9V5

Effective Period:

The terms and conditions set out in the Permit apply to the existing or planned works on
July 01, 2026

All previous versions of this Waste Discharge Permit are hereby rescinded and rendered null and void as of the
start of the effective period stated above.

Issued: March 01, 2016
Amended: June 03, 2026


Maari Hirvi Mayne, M.Eng., P.Eng.
Deputy Sewage Control Manager

GREATER VANCOUVER SEWERAGE & DRAINAGE DISTRICT

SCHEDULE A

This Schedule sets out requirements for the quantity and quality of the discharge to Sewer.

1. AUTHORIZED RATE OF DISCHARGE

The Permittee must not exceed the following:

Sample Point: 1

- Maximum daily discharge flow rate: **350.00 m³/d**
- Maximum instantaneous peak flow rate: **5.90 L/s**

2. AUTHORIZED DISCHARGE CRITERIA

- a) The Permittee must not discharge Restricted Waste or other Waste, as defined in the Bylaw, including but not limited to the following (regardless of sample type):


Parameter	Authorized Limit	Notes
pH	5.5 - 10.5 pH Units	
Total Suspended Solids	600 mg/L	
Total Oil & Grease	150 mg/L	

- b) The Permittee must not discharge Restricted Waste or other Waste, as defined in the Bylaw, with the following exceptions (regardless of sample type):

Parameter	Authorized Limit	Notes
Biochemical Oxygen Demand	3000 mg/L	
Biochemical Oxygen Demand	460 kg/d	Daily loading

- c) The Permittee must not discharge Prohibited Waste, Storm Water or Uncontaminated Water, as defined in the Bylaw.
- d) The Permittee must not discharge Hazardous Waste, or effluent from the treatment of Hazardous Waste which exceeds the Effluent Standards for Hazardous Waste Facilities, as stipulated in Schedule 1.2, Column 3, of the BC Environmental Management Act Hazardous Waste Regulation.

Issued: March 01, 2016
Amended: June 03, 2026


Maari Hirvi Mayne, M.Eng., P.Eng.
Deputy Sewage Control Manager

Waste Discharge Permit No. SC-101031-FSA

GREATER VANCOUVER SEWERAGE & DRAINAGE DISTRICT

SCHEDULE B

This Schedule sets out requirements and locations for the approved sample points, waste sources, and works and procedures to treat and/or control the discharges to Sewer.

1. SAMPLE POINTS, WASTE SOURCES, WORKS & PROCEDURES

SAMPLE POINT: 1

This sample point is considered to be a point of discharge to Sewer. The approved sample point location is described and is illustrated in the photo(s) below.

Description: The underground tank in the front paved yard prior to final discharge to sewer.

Source: Fresh Production Room (roe herring)

Brine freezer tank
Slush ice from herring fish totes

Type: Continuous

Works and Procedures	Completion Date
Sediment filter socks	Completed
Good operating practices	Completed
Continuous flow monitoring and recording	Completed


Source: All Other Plant Sources

Cleaning and sanitation
Fish processing, freezing and grinding
Slush ice from fish totes

Type: Continuous

Works and Procedures	Completion Date
Sediment filter socks	Completed
Effluent storage tank	Completed
Rotary screen	Completed
Trade waste interceptor	Completed
Continuous flow monitoring and recording (main meter reading minus total of readings from three sanitary meters)	Completed
Good operating practices	Completed

Issued: March 01, 2016
Amended: June 03, 2026

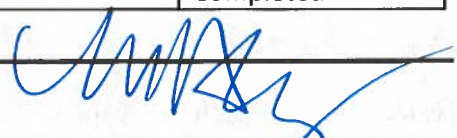


Maari Hirvi Mayne, M.Eng., P.Eng.
Deputy Sewage Control Manager

Waste Discharge Permit No. SC-101031-FSA

GREATER VANCOUVER SEWERAGE & DRAINAGE DISTRICT

SCHEDULE B

Photograph of Sample Point 1:

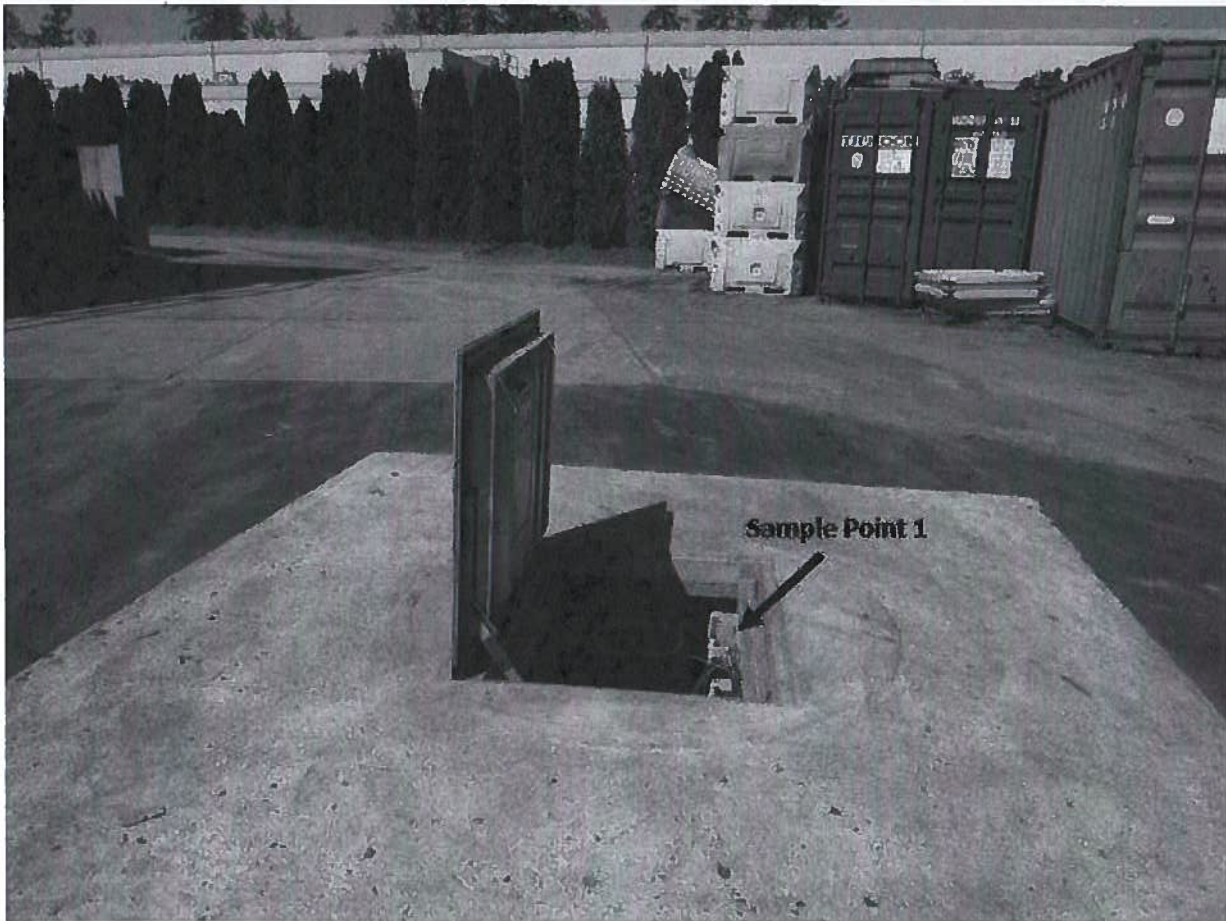

Issued: March 01, 2016
Amended: June 03, 2026


Waste Discharge Permit No. SC-101031-FSA

Maari Hirvi Mayne, M.Eng., P.Eng.
Deputy Sewage Control Manager

GREATER VANCOUVER SEWERAGE & DRAINAGE DISTRICT

SCHEDULE B


2. SITE PLAN(S)

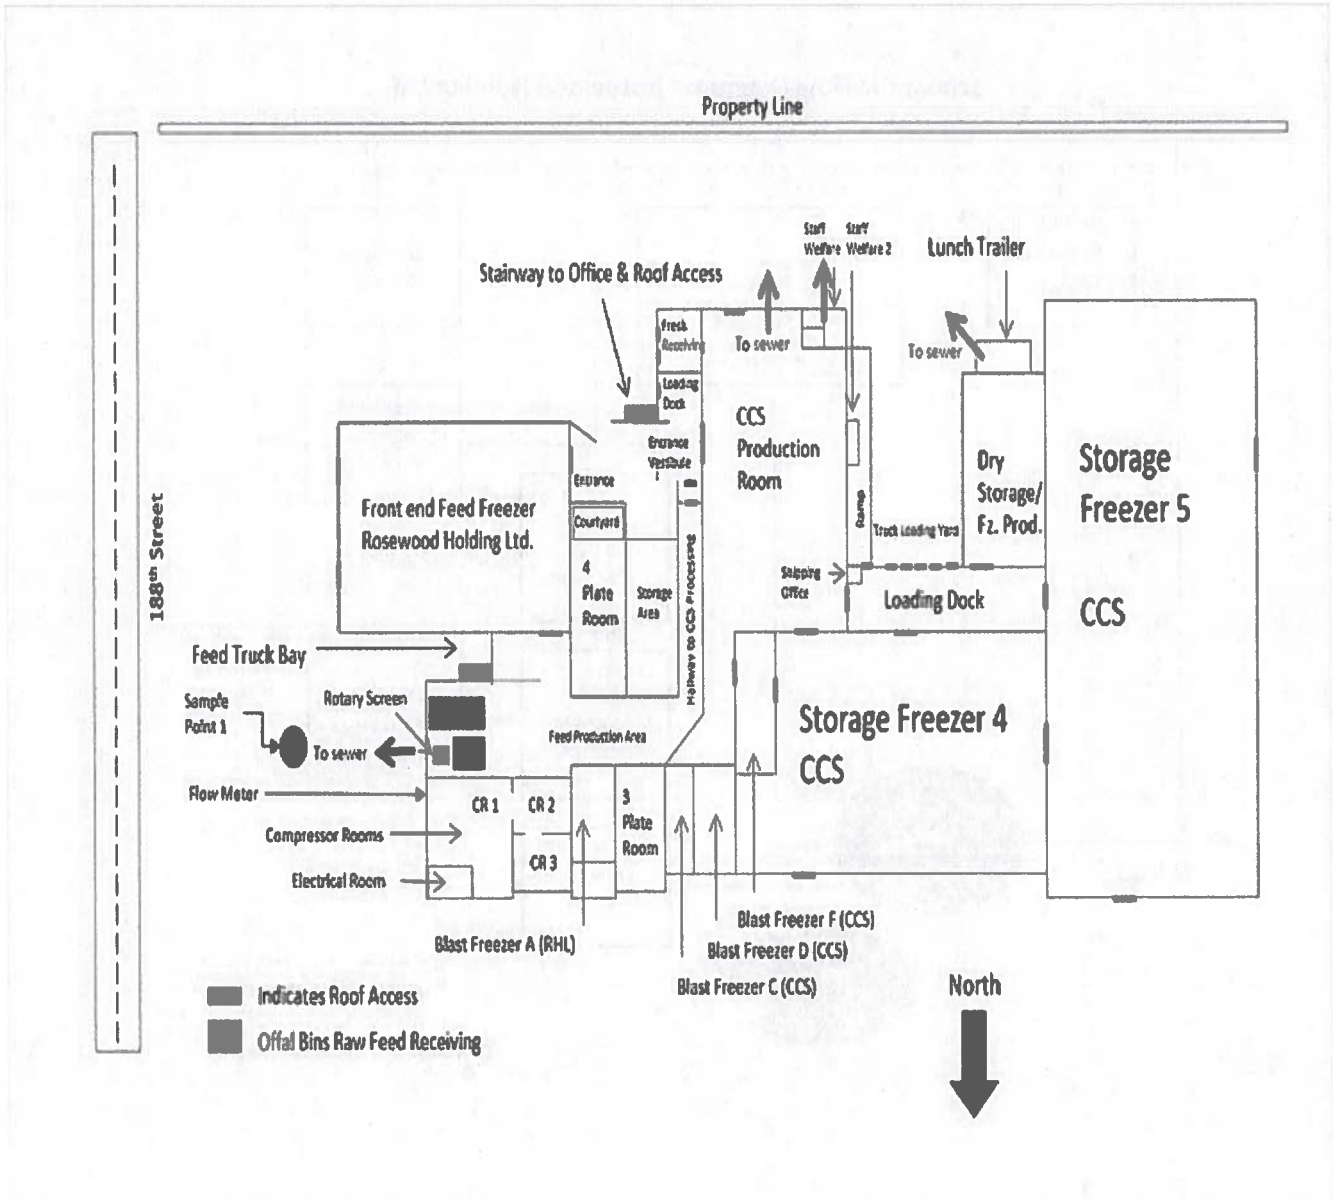

Issued: March 01, 2016

Amended: June 03, 2026

Waste Discharge Permit No. SC-101031-FSA



Maari Hirvi Mayne, M.Eng., P.Eng.
Deputy Sewage Control Manager

GREATER VANCOUVER SEWERAGE & DRAINAGE DISTRICT

SCHEDULE B

Schematic Flow Diagram

Schematic Flow Diagram - Rosewood Holding Ltd.

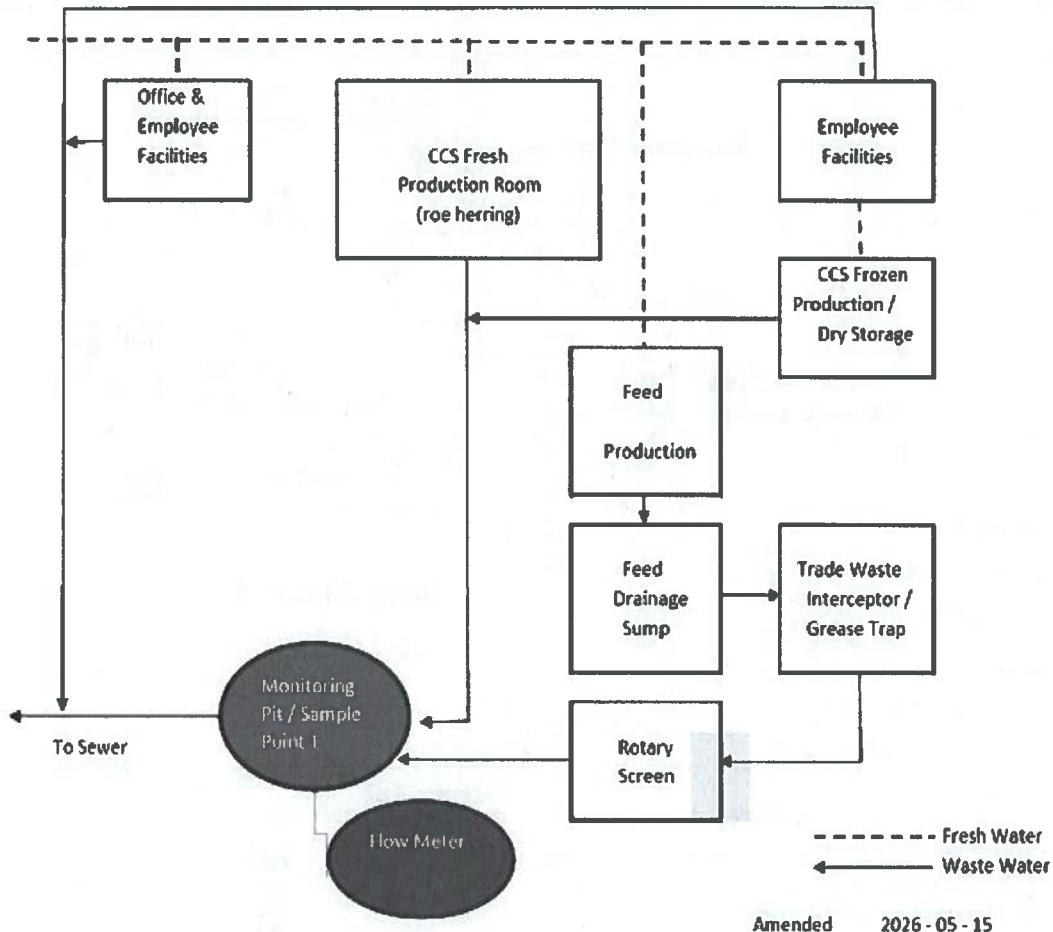

Issued: March 01, 2016
Amended: June 03, 2026

Maari Hirvi Mayne, M.Eng., P.Eng.
Deputy Sewage Control Manager

Waste Discharge Permit No. SC-101031-FSA

GREATER VANCOUVER SEWERAGE & DRAINAGE DISTRICT

SCHEDULE C

This Schedule sets out standard conditions and requirements for emergency procedures.

1. STANDARD CONDITIONS

- a) Except as otherwise provided in this Permit, all terms, conditions and definitions stipulated in the Bylaw also apply to this Permit.
- b) Pursuant to the Bylaw, the Sewage Control Manager (the Manager) may amend the terms and conditions of this Permit.
- c) All records required by this permit must be kept available for inspection for a minimum period of three years.

2. WORKS AND PROCEDURES

- a) All authorized works, procedures and requirements must be employed at all times during any discharge to sewer. As applicable, all such works must be inspected and calibrated regularly and maintained in good working condition.
- b) The Manager may require that additional works be installed if the existing works do not provide an acceptable level of treatment. The Manager may authorize new works or alterations to existing works. The Manager may authorize new waste sources.

3. NOTIFICATION PROCEDURES

The Permittee must immediately report to Metro Vancouver by phone: 8:00 AM -11:30 PM at 604-436-6777, 11:30 PM – 8:00 AM at 604-643-8488 and by email: EREnotifications@metrovancouver.org:

- a) Spills with the potential to be discharged to the Sanitary Sewer.
- b) Failure of authorized works or conditions and/or failure to carry out authorized procedures that will or have the potential to result in a Permit limit being exceeded.
- c) Discharge pH less than 2 or greater than 12.5.

4. BY-PASSES

The discharge of Wastes that by-pass any authorized works or that is not in accordance with procedures designated by the Permit is prohibited, unless prior authorization has been obtained and confirmed in writing from the Manager.

5. DISCHARGE MONITORING

- a) All sampling and sample handling of wastewater discharges, including sample containers, storage, preservation and hold time requirements must be carried out in accordance with all prescribed requirements stated within the latest edition of the "British Columbia Environmental Laboratory Manual" published by the Ministry of Environment and Climate Change Strategy, Province of British Columbia or "Standard Methods for the Examination of Water and Wastewater" published by the American Public Health Association, or an alternate standard authorized by the Manager.

Issued: March 01, 2016
Amended: June 03, 2026


Maari Hirvi Mayne, M.Eng., P.Eng.
Deputy Sewage Control Manager

Waste Discharge Permit No. SC-101031-FSA

GREATER VANCOUVER SEWERAGE & DRAINAGE DISTRICT

SCHEDULE C

- b) With the exception of pH measurements, all samples must be analyzed by an independent laboratory accredited through the latest version of ISO/IEC 17025 unless otherwise authorized by the Manager.
- c) Laboratories used by the Permittee must also be accredited by the Canadian Association for Laboratory Accreditation and/or the Standards Council of Canada for all parameters analyzed and must participate in relevant proficiency testing programs for each parameter.
- d) Any changes in method or location of monitoring must be authorized by the Manager.
- e) Additional monitoring and/or reporting must be undertaken by the Permittee when required by the Manager.

Issued: March 01, 2016
Amended: June 03, 2026



Maari Hirvi Mayne, M.Eng., P.Eng.
Deputy Sewage Control Manager

Waste Discharge Permit No. SC-101031-FSA

GREATER VANCOUVER SEWERAGE & DRAINAGE DISTRICT

SCHEDULE D

This Schedule sets out the requirements for the monitoring of the discharge to Sewer.

DISCHARGE SAMPLING AND ANALYSES: Effective July 01, 2026

1. FLOW MEASUREMENTS

The Permittee must measure or estimate the discharge flow to sanitary sewer during each month of operation using the method(s) authorized in Schedule B and record for reporting purposes the following:

- Total discharge volume (m³) for the month, for sample point(s) 1
- Total discharge volume (m³) for each day of the month, for sample point(s) 1
- Number of days of discharge to sanitary sewer during each calendar month, for sample point(s) 1
- Maximum daily discharge flow rate (m³/d) during each calendar month, for sample point(s) 1

2. SAMPLING PROGRAM

Continuous Discharge Sampling:

The Permittee must record for reporting purposes for each sample the following:

- Sample date
- Sample collection time or sample collection start and stop time(s) if applicable
- Total daily discharge volume (m³) on the date of sampling

SAMPLE POINT: 1

Continuous Discharges:

On one normal operating day once per month collect 1 set of grab samples and analyze for:


- pH
- Total Oil & Grease
- Chloride

On one normal operating day once per month collect 1 set of composite samples and analyze for:

- Biochemical Oxygen Demand
- Total Suspended Solids
- Conductivity

Grab sample pH analysis must be conducted immediately upon sampling.

Issued: March 01, 2016
Amended: June 03, 2026


Maari Hirvi Mayne, M.Eng., P.Eng.
Deputy Sewage Control Manager

Waste Discharge Permit No. SC-101031-FSA

GREATER VANCOUVER SEWERAGE & DRAINAGE DISTRICT

SCHEDULE D

Unless otherwise specified, composite samples must consist of equal portions of grab samples, collected at a frequency of at least one per hour during discharge to sewer.

If composite sampling is specified, grab samples must be taken during the period of composite sampling unless noted otherwise in this Schedule.

Unless otherwise specified, all samples should be taken during normal operations.

Issued: March 01, 2016
Amended: June 03, 2026



Maari Hirvi Mayne, M.Eng., P.Eng.
Deputy Sewage Control Manager

Waste Discharge Permit No. SC-101031-FSA

GREATER VANCOUVER SEWERAGE & DRAINAGE DISTRICT

SCHEDULE E

This Schedule sets out reporting requirements for this Permit.

1. REPORTING REQUIREMENTS

By July 31, 2026 and quarterly thereafter for the term of this permit:

The Permittee must submit a report, for the previous quarter, which includes


- the results of the discharge sampling and analyses program, as specified,
- lab reports and,
- daily discharge flow reports.

This information must be submitted electronically using the supplied password-enabled web based application.

For every violation of any term or condition of the Permit, the report must include a summary of the cause(s) of the violation and the corrective actions taken or proposed to prevent future violations.

This does not preclude the emergency notification requirements specified in Schedule C.

Issued: March 01, 2016
Amended: June 03, 2026



Maari Hirvi Mayne, M.Eng., P.Eng.
Deputy Sewage Control Manager

Waste Discharge Permit No. SC-101031-FSA