



**A. Lanfranco
& Associates Inc.**

Environmental Consultants

Prepared for

METRO VANCOUVER

Metrotower III

**4515 Central Boulevard
Burnaby, BC V5H 0C6**

Waste-to-Energy Facility

Third Quarter 2025 Emissions Test Report

Operational Certificate 107051

Prepared by Mr. Louis Agassiz

Issued: September 3, 2025

CERTIFICATION

The field monitoring for this survey was conducted by certified stack test technicians as required by the British Columbia Ministry of Environment and Parks (BC MOE) Field Sampling Manual.

The field crew consisted of:

Mr. C. Lanfranco (certified), Mr. L. Agassiz (certified), Mr. S. Verby (certified), Mr. L. Forrer (certified), and Mr. J. Dennis.

The report was prepared by Mr. L. Agassiz using reporting principles and guidelines generally acceptable to Metro Vancouver (MV).

The field crew and A. Lanfranco and Associates Inc. certify that the test methods used were BC MOE/MV approved reference methods for the parameters investigated.

Report reviewed on September 3, 2025, by:


Mr. Mark Lanfranco
Principal | Owner

TEST PROGRAM ORGANIZATION

Primary Stakeholders:

Mr. Brent Kirkpatrick
Metro Vancouver
Lead Senior Engineer
Email: brent.kirkpatrick@metrovancover.org
Tel: (604) 451-6623

Mr. Brian Graham
Veolia Canada
Operations Manager / Chief Power Engineer
Email: brian.graham@veolia.com
Tel: (587) 892-1381

Project Manager:

Mr. Mark Lanfranco
President | Owner
A. Lanfranco and Associates Inc.
101 – 9488 189 St
Surrey, BC Canada V4N 4W7
Tel: (604) 881-2582
Email: mark.lanfranco@alanfranco.com

Sampling Crew:

Mr. L. Agassiz - A. Lanfranco and Associates Inc.
Mr. S. Verby - A. Lanfranco and Associates Inc.
Mr. C. Lanfranco - A. Lanfranco and Associates Inc.
Mr. L. Forrer - A. Lanfranco and Associates Inc.
Mr. J. Dennis - A. Lanfranco and Associates Inc.

Table of Contents

TEST PROGRAM ORGANIZATION	2
SUMMARY	4
1 INTRODUCTION	5
2 METHODOLOGY	6
2.1 Sampling and Analytical Methods	6
3 DETAILED TEST RESULTS	12
4 DISCUSSION	21

List of Tables

Table 1: Summary Comparison of Emissions Test Results with Limits	4
Table 2: Reference Methods	6
Table 3: Unit 1 Summary of Emission Test Results	12
Table 4: Unit 1 Trace Metals Emissions (OC Class)	13
Table 5: Unit 1 Detailed Trace Metals Emissions	13
Table 6: Unit 1 - Summary of Operating Data	14
Table 7: Unit 2 Summary of Emission Test Results	15
Table 8: Unit 2 Trace Metals Emissions (OC Class)	16
Table 9: Unit 2 Detailed Trace Metals Emissions	16
Table 10: Unit 2 - Summary of Operating Data	17
Table 11: Unit 3 Summary of Emission Test Results	18
Table 12: Unit 3 Trace Metals Emissions (OC Class)	19
Table 13: Unit 3 Detailed Trace Metals Emissions	19
Table 14: Unit 3 - Summary of Operating Data	20

List of Figures

Figure 1: Example showing circular stack cross section divided	7
Figure 2: Type S Pitot Tube Manometer Assembly	7
Figure 3: Particulate / Trace Metals Sampling Train	9

SUMMARY

The following table displays the emission results from the three units located at Metro Vancouver's Waste-To-Energy Facility (WTEF) as well as the current emission limits as defined by the Operational Certificate (OC) issued by BC Ministry of Environment and Parks. This compliance survey represents the third quarter of 2025.

Table 1: Summary Comparison of Emissions Test Results with Limits

SUMMARY TABLE: COMPARISON OF EMISSION TEST RESULTS WITH LIMITS

Parameter	Limit	Unit 1	Unit 2	Unit 3	Facility Average
Test Date		July 14-15, 2025	July 15-16, 2025	July 16-17, 2025	
Particulate (mg/Sm ³ @ 11% O ₂)	9.0	1.20	2.06	0.56	1.27
Hydrogen Fluoride (mg/Sm ³ @ 11% O ₂)	1.0	0.089	0.084	0.122	0.10
Trace Metals - OC Class (mg/Sm ³ @ 11% O ₂)					
Lead (Pb)	-	0.0014	0.0038	0.0013	0.0022
Arsenic (As)	-	0.0010	0.0010	0.0009	0.0010
Chromium (Cr)	-	0.0006	0.0060	0.0103	0.0056
OC Class Sum (Pb, As and Cr)	0.064	0.0031	0.0107	0.0125	0.0088
Mercury (mg/Sm ³ @ 11% O ₂)	0.02	0.000096	0.000492	0.000049	0.00021
Cadmium (mg/Sm ³ @ 11% O ₂)	0.007	0.000091	0.000298	0.000090	0.00016

All data is corrected to standard conditions (S) of 20 °C, 101.325 kPa (dry) unless otherwise noted.

The test results are very similar to those from Q2 2025. The variability observed quarter-to-quarter is well within a normal range of outcomes for this operation and is not considered significant.

1 INTRODUCTION

Metro Vancouver (MV) commissioned an emission survey at the Waste-To-Energy Facility (WTEF) in Burnaby BC, as required by the provincially approved Operational Certificate (OC). Stationary source monitoring is required Quarterly.

The individual sources that were monitored for compliance are identified as Unit 1, Unit 2 and Unit 3 which represent the three distinct processing lines at the WTEF. The three boilers are identified as discharge E300670 in the operational certificate.

The survey included monitoring for: filterable particulate matter, trace metals, mercury (Hg), hydrogen fluoride (HF), hydrogen chloride (HCl), ammonia (NH₃), nitrous oxide (N₂O) and volatile organic compounds (VOC).

A. Lanfranco and Associates Inc. (ALAA), of Surrey, B.C., conducted the sampling program on behalf of MV. The sampling program consisted of, but was not limited to, the planning, execution, analysis, and reporting of three emission sources located at the WTEF.

This report includes a comparison of emission results to limits established in the OC, detailed emission results, a brief outline of methods employed, equipment used, and a discussion of the survey. All supporting data and appendices are presented under separate cover.

The appendices for this report, including computer outputs of calculated data, analytical data, field data sheets, calibrations, and professional certifications are issued separately.

2 METHODOLOGY

All services provided by A. Lanfranco and Associates Inc. were conducted in accordance with approved reference methods as issued by:

- Metro Vancouver (MV)
- BC Ministry of Environment & Parks (BC MOE)
- Environment Canada (EC)
- US Environmental Protection Agency (EPA)

2.1 Sampling and Analytical Methods

The following table lists the test methods used for the different parameters measured. The subsequent paragraphs briefly describe each method.

Table 2: Reference Methods

<u>Parameter</u>	<u>Reference Method</u>
Sample and Velocity traverse points	EPS 1/RM/8 A Determination of Sampling Site and Traverse Points
Velocity and flowrate	EPS 1/RM/8 B Determination of Stack Gas Velocity and Volumetric Flow Rate (Type S Pitot Tube)
Gas molecular weight (O ₂ /CO ₂)	EPS 1/RM/8 C Determination of Molecular Weight by Gas Analysis
Flue gas Moisture	EPS 1/RM/8 D Determination of Moisture Content
Particulate Matter	EPS 1/RM/8 E Determination of Particulate Matter Emissions from Stationary Sources
Trace Metals with Mercury	EPA Method 29 Determination of Metals Emissions from Stationary Sources
Hydrogen Fluoride (HF) Hydrogen Chloride (HCl)	EPS1/RM/1 Reference Method for Source Testing: Measurement of Releases of Gaseous Hydrogen Chloride from Stationary Sources
Nitrous Oxide (N ₂ O)	N/A
Ammonia	EPA Method CTM 027 Procedure For Collection and Analysis of Ammonia in Stationary Sources
Volatile Organic Compounds (VOC)	EPA Method TO-15 Determination of Volatile Organic Compounds in Air

Sampling Site and Traverse Points

This method is designed to aid in the representative measurement of pollutant emissions and/or total volumetric flow rate from a stationary source. A measurement site where the effluent stream is flowing in a known direction is selected, and the cross-section of the stack is divided into a number of equal areas. Traverse points are then located within each of these equal areas.

Primary: EPS 1/RM/8 Method A
 Supporting: EPA Method 1

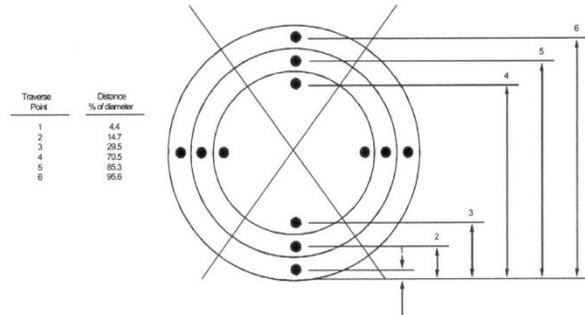


Figure 1: Example showing circular stack cross section divided

Stack Gas Velocity and Volumetric Flow Rate

The average gas velocity in a stack or duct is determined from the gas density and from the measurement of velocity pressure with an S-type pitot tube. A standard pitot tube may be used where plugging of the tube openings due to particulate matter and/or moisture is not likely to occur. Stack gas volumetric flow rate is determined from measurements of stack gas velocity, temperature, absolute pressure, dry gas composition, moisture content, and stack diameter.

Primary: EPS 1/RM/8 Method B
 Supporting: EPA Method 2

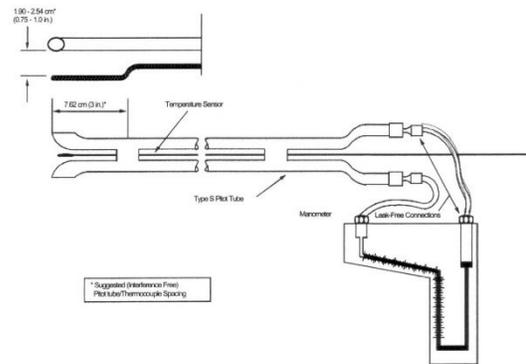


Figure 2: Type S Pitot Tube Manometer Assembly

Molecular Weight by Gas Analysis

Primary: EPS 1/RM/8 Method C
Supporting: EPA Method 3

An integrated or grab sample is extracted from a single point in the gas stream and analyzed for its components using a Fyrite analyzer, a gas chromatograph, or calibrated continuous analyzers.

Moisture Content

Primary: EPS 1/RM/8 Method D
Supporting: EPA Method 4

A gas sample is extracted from a single point in the enclosed gas stream being sampled. The moisture is condensed, and its weight measured. This weight, together with the volume of gas sampled, enables the stack gas moisture content to be calculated.

Particulate Matter

Primary: EPS 1/RM/8 Method E
Supporting: EPA Method 5

Particulate matter is withdrawn isokinetically from a number of sampling or traverse points in an enclosed gas stream. The particulate sample is collected in the nozzle, probe, and on a glass fibre filter, all maintained at a temperature of $120 \pm 14^{\circ}\text{C}$ or such other temperature as is necessary to prevent blinding of the filter from condensation. The particulate weight is determined gravimetrically after removal of uncombined water. Simultaneous determinations of the gas stream moisture content, velocity, temperature, and molecular weight allow calculations of the particulate concentration and the particulate mass emission or release rate to be made.

Trace Metal

Primary: EPA Method 29 (modified)

This method is used in conjunction with the above Method 5. A stack sample is withdrawn isokinetically from the source. Particulate emissions are collected in the probe and on a heated filter, and gaseous emissions are then collected in an aqueous acidic solution of hydrogen peroxide (analyzed for all metals including Hg) and an aqueous acidic solution of potassium permanganate (analyzed only for Hg). The recovered samples are digested, and appropriate fractions are analyzed for Hg by cold vapour atomic absorption spectroscopy (CVAAS). The remaining trace metals are analyzed with inductively coupled argon plasma emission spectroscopy (ICAP), atomic absorption spectroscopy (AAS) and graphite furnace atomic absorption spectroscopy (GFAAS). Figure 3 presents the sample train and its configuration.

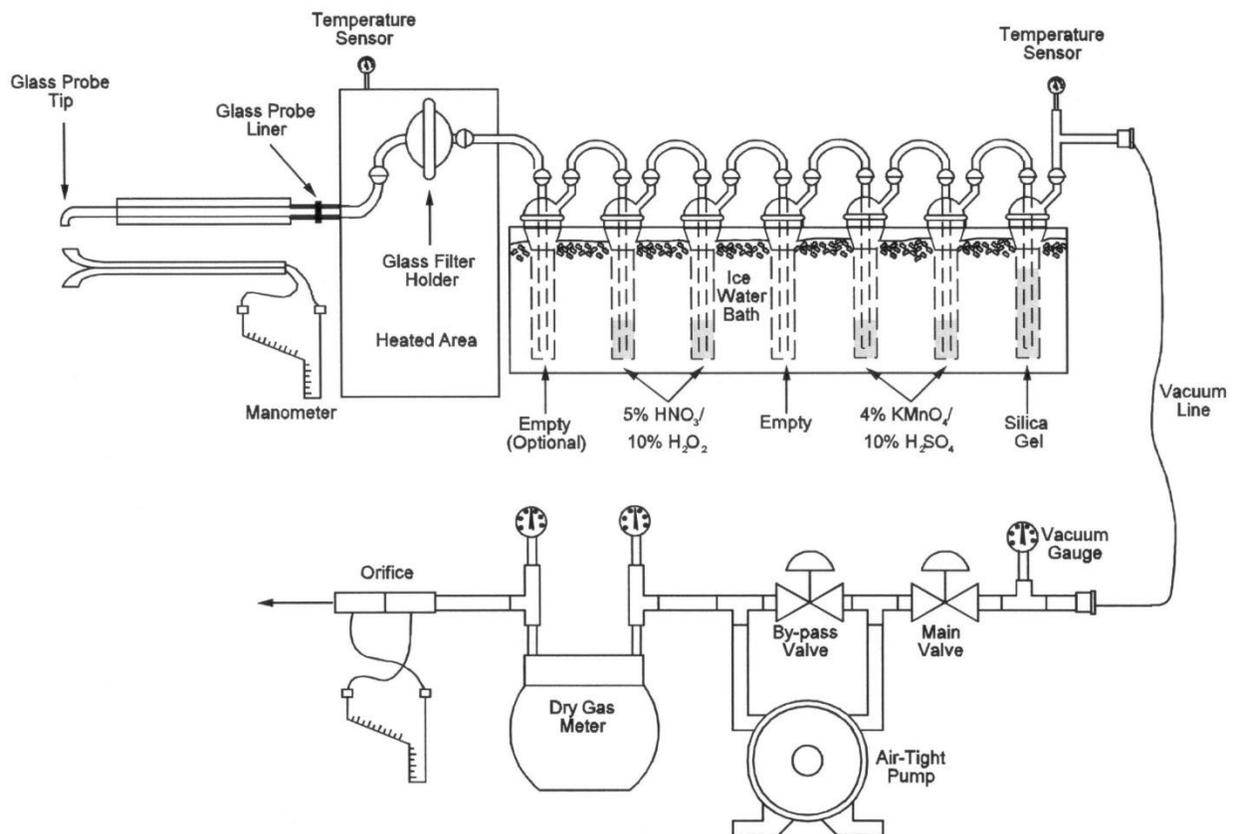


Figure 3: Particulate / Trace Metals Sampling Train

Hydrogen Fluoride

Primary: EPS 1/RM/1

Supporting: BC Method 7176106 & 7066101

HF is sampled in a four-impinger train consisting of two impingers containing distilled/deionized H₂O, one empty impinger, and a fourth containing silica gel. A sample of the stack gas is extracted from a single point near the centre of the stack over the sample duration at a constant rate. The collected samples are measured for F by ion chromatography at Element laboratory in Surrey, BC.

Hydrogen Chloride

Primary: EPS 1/RM/1

A sample of the stack gas is extracted from a single point near the centre of the stack over a sampling duration of 60 minutes. After the removal of particulate matter from the sample gas, hydrogen chloride is collected by impingement in a series of impingers containing measured amounts of distilled or deionized water. The resulting solutions are analyzed for chlorides by ion chromatography at Element laboratory in Surrey, BC.

N₂O

Primary: US EPA Method 18

Three N₂O samples were collected from each source using evacuated tedlar bag sampling procedures. Each bag was purged and evacuated on-site with small amounts of stack gas, prior to final stack gas collection. Each bag sample was an integrated type sample where stack gases were collected over sixty minute periods. The bag sampling was conducted over about a four hour period.

The samples were analyzed at Bureau Veritas in Mississauga, ON by SOP-00203 utilizing GC/ECD.

Ammonia

Primary: EPA Method CTM-027

The absorbing solution in the first two impingers is 0.1 N H₂SO₄ and the triplicate samples were extracted at a constant rate for 60-minute durations. The collected samples are analyzed at Element laboratory in Surrey, BC.

Method Modifications

Three minor method modifications were instituted for this work.

1. Reagent blanks for metals trains were made to the same volumes as all samples. In other words, exactly 100 ml of the various reagents used to recover samples was NOT done, as some sample components (probe washing for example) required more than 100 ml to adequately clean and rinse the probe. Instead, sample recovery was conducted with however much rinsing was deemed adequate. In the laboratory, the blanks and samples were made up with the appropriate reagent so that all samples and blanks were the same volume.
2. Filter and residue weighing were not conducted with the six-hour interval technique. Instead, the sample filters and beakers were conditioned with cooling and desiccation and then weighed on two separate laboratory scales after 24 hours. Duplicate or triplicate Blank samples were carried through the gravimetric analysis, and the sample results were adjusted with the Blank data to determine the net filter and probe wash residue weight gain. This is the Environment Canada approved modified approach for weighing probe wash residue.
3. For the purposes of calculating a result, all parameters were given the value of $\frac{1}{2}$ the detection limit when the analysis yielded 'non-detect' results.

All results are expressed using the metric system and corrected to standard conditions of 20 °C and 101.325 kPa, dry gas (unless otherwise noted).

3 DETAILED TEST RESULTS

The results of stack emissions were calculated using a “STACK” computer program developed by A. Lanfranco and Associates for BC MOE requirements.

Tables 3-14 present the detailed results of all emissions parameters tested and operational conditions for each of the units. Additional data and the computer outputs can be found in the accompanying Appendices.

Table 3: Unit 1 Summary of Emission Test Results

Parameter	Run 1	Run 2	Run 3	Average
Test Date - Particulate/Metals	14-Jul-25	15-Jul-25	15-Jul-25	
Test Time - Particulate/Metals	11:24 - 13:28	09:18 - 11:20	11:47 - 13:49	
Duration - Minutes	120	120	120	
Test Date - Acid Gases	15-Jul-25	15-Jul-25	15-Jul-25	
Test Time - Acid Gases	09:44 - 10:44	10:58 - 11:58	12:10 - 13:10	
Duration - Minutes	60	60	60	
Stack Temperature (°C)	158	157	159	158
Average Gas Velocity (m/s)	14.7	14.5	14.7	14.6
Dry Flow Rate (Sm ³ /min)	1204	1254	1256	1238
Moisture (Vol. %)	17.5	13.7	14.4	15.2
Oxygen (Vol. %)(dry basis)	9.8	9.6	10.0	9.8
Carbon Dioxide (Vol. %)(dry basis)	9.98	10.08	9.95	10.01
Particulate (mg/Sm ³ @ 11% O ₂)	2.82	0.13	0.66	1.20
Hydrogen Fluoride (mg/Sm ³ @ 11% O ₂)	0.013	0.128	0.125	0.089
Hydrogen Chloride (mg/Sm ³ @ 11% O ₂)	11.1	29.4	30.1	23.6
Ammonia (mg/Sm ³ @ 11% O ₂)	27.3	17.2	24.1	22.9
Nitrous Oxide (mg/Sm ³ @ 11% O ₂)*	6.05	6.12	4.64	5.60
Total Hydrocarbons (mg/Sm ³ @ 11% O ₂)	5.54	5.28	7.53	6.12
Trace Metals - Operational Certificate List (mg/Sm³ @ 11% O₂)				
OC Class (Pb, As and Cr)	0.00577	0.00120	0.00224	0.00307
Aluminum (mg/Sm ³ @ 11% O ₂)	0.07754	0.00580	0.01466	0.03267
Cadmium (mg/Sm ³ @ 11% O ₂)	0.00009	0.00009	0.00009	0.00009
Lead (mg/Sm ³ @ 11% O ₂)	0.00310	0.00054	0.00055	0.00140
Mercury (mg/Sm ³ @ 11% O ₂)	0.00006	0.00018	0.00005	0.000096
Phosphorus (mg/Sm ³ @ 11% O ₂)	0.01071	0.00616	0.00082	0.00590
Isokinetic Variation (%)	107	103	105	105

All data is corrected to standard conditions (S) of 20 °C, 101.325 kPa (dry) unless otherwise noted.

Table 4: Unit 1 Trace Metals Emissions (OC Class)

Metal	Test 1 (mg/m ³ @ 11% O ₂)	Test 2 (mg/m ³ @ 11% O ₂)	Test 3 (mg/m ³ @ 11% O ₂)	Average (mg/m ³ @ 11% O ₂)
OC Class				
Pb	0.00310	0.00054	0.00055	0.00140
As	0.00092	0.00058	0.00161	0.00104
Cr	0.00175	0.00007	0.00007	0.00063
Sum of OC Class	0.00577	0.00120	0.00224	0.00307
Other				
Al	0.07754	0.00580	0.01466	0.03267
Cd	0.00009	0.00009	0.00009	0.00009
P	0.01071	0.00616	0.00082	0.00590
Hg	0.00006	0.00018	0.00005	0.00010

All data is corrected to standard conditions (S) of 20 °C, 101.325 kPa (dry) unless otherwise noted.

Table 5: Unit 1 Detailed Trace Metals Emissions

Metal	Test 1 (mg/m ³ @ 11% O ₂)	Test 2 (mg/m ³ @ 11% O ₂)	Test 3 (mg/m ³ @ 11% O ₂)	Average (mg/m ³ @ 11% O ₂)
Pb	0.00310	0.00054	0.00055	0.00140
Sb	0.00092	0.00091	0.00156	0.00113
Cu	0.00078	0.00072	0.00041	0.00064
Mn	0.00535	0.00015	0.00023	0.00191
V	0.00037	0.00036	0.00037	0.00037
Zn	0.01363	0.00561	0.00861	0.00928
As	0.00092	0.00058	0.00161	0.00104
Cr	0.00175	0.00007	0.00007	0.00063
Co	0.00009	0.00009	0.00009	0.00009
Ni	0.00138	0.00081	0.00018	0.00079
Se	0.00055	0.00054	0.00592	0.00234
Te	0.00026	0.00072	0.00099	0.00066
Tl	0.00055	0.00054	0.00055	0.00055
Cd	0.00009	0.00009	0.00009	0.00009
Hg	0.00006	0.00018	0.00005	0.00010

All data is corrected to standard conditions (S) of 20 °C, 101.325 kPa (dry) unless otherwise noted.

Table 6: Unit 1 - Summary of Operating Data

Parameter		Run 1	Run 2	Run 3	Normal
Test Date - Particulate/Metals		14-Jul-25	15-Jul-25	15-Jul-25	
Test Time - Particulate/Metals		11:24 - 13:28	09:18 - 11:20	11:47 - 13:49	
Boiler Steam Production	(kg/h)	36,587	35,888	35,590	33,631
Percentage of normal	(%)	109%	107%	106%	
Boiler Secondary Combustion Zone Temp	(°C)	936.5	904	908	928
Percentage of normal	(%)	101%	97%	98%	
Rate of refuse fired	(kg/hr)	10,921	10,713	10,624	10,039
Percentage of normal	(%)	109%	107%	106%	
Rate of aux. fuel fired (Natural Gas)	m ³ /hr	0	0	0	58
Percentage of normal (%)	(%)	0%	0%	0%	

*Normal refers to the average operating rate from the previous 30 days

Table 7: Unit 2 Summary of Emission Test Results

Parameter	Run 1	Run 2	Run 3	Average
Test Date - Particulate/Metals	15-Jul-25	16-Jul-25	16-Jul-25	
Test Time - Particulate/Metals	10:33 - 12:35	09:10 - 11:12	11:40 - 13:42	
Duration - Minutes	120	120	120	
Test Date - Acid Gases	16-Jul-25	16-Jul-25	16-Jul-25	
Test Time - Acid Gases	09:23 - 10:23	10:39 - 11:39	11:55 - 12:55	
Duration - Minutes	60	60	60	
Stack Temperature (°C)	153	157	157	156
Average Gas Velocity (m/s)	12.5	13.0	12.9	12.8
Dry Flow Rate (Sm ³ /min)	1073	1107	1087	1089
Moisture (Vol. %)	14.7	15.1	16.0	15.3
Oxygen (Vol. %)(dry basis)	9.90	9.62	9.45	9.66
Carbon Dioxide (Vol. %)(dry basis)	8.95	9.29	9.59	9.28
Particulate (mg/Sm³ @ 11% O₂)	1.35	0.92	3.89	2.06
Hydrogen Fluoride (mg/Sm³ @ 11% O₂)	0.121	0.012	0.120	0.084
Hydrogen Chloride (mg/Sm³ @ 11% O₂)	25.3	19.0	49.9	31.4
Ammonia (mg/Sm³ @ 11% O₂)	18.2	24.9	13.3	18.8
Nitrous Oxide (mg/Sm³ @ 11% O₂)*	5.61	5.46	6.49	5.86
Total Hydrocarbons (mg/Sm³ @ 11% O₂)	5.47	5.27	5.72	5.48
Trace Metals - Operational Certificate List (mg/Sm³ @ 11% O₂)				
OC Class (Pb, As and Cr)	0.00451	0.01510	0.01261	0.01074
Aluminum (mg/Sm³ @ 11% O₂)	0.01264	0.02722	0.01190	0.01725
Cadmium (mg/Sm³ @ 11% O₂)	0.00032	0.00038	0.00020	0.00030
Lead (mg/Sm³ @ 11% O₂)	0.00200	0.00563	0.00367	0.00376
Mercury (mg/Sm³ @ 11% O₂)	0.00006	0.00037	0.00105	0.00049
Phosphorus (mg/Sm³ @ 11% O₂)	0.00068	0.00168	0.00161	0.00132
Isokinetic Variation (%)	105	104	105	105

All data is corrected to standard conditions (S) of 20 °C, 101.325 kPa (dry) unless otherwise noted.

Table 8: Unit 2 Trace Metals Emissions (OC Class)

Metal	Test 1 (mg/m ³ @ 11% O ₂)	Test 2 (mg/m ³ @ 11% O ₂)	Test 3 (mg/m ³ @ 11% O ₂)	Average (mg/m ³ @ 11% O ₂)
OC Class				
Pb	0.0020	0.0056	0.0037	0.0038
As	0.0023	0.0003	0.0003	0.0010
Cr	0.0002	0.0091	0.0086	0.0060
Sum of OC Class	0.0045	0.0151	0.0126	0.0107
Other				
Al	0.01264	0.02722	0.01190	0.0173
Cd	0.00032	0.00038	0.00020	0.0003
P	0.00068	0.00168	0.00161	0.0013
Hg	0.00006	0.00037	0.00105	0.00049

All data is corrected to standard conditions (S) of 20 °C, 101.325 kPa (dry) unless otherwise noted.

Table 9: Unit 2 Detailed Trace Metals Emissions

Metal	Test 1 (mg/m ³ @ 11% O ₂)	Test 2 (mg/m ³ @ 11% O ₂)	Test 3 (mg/m ³ @ 11% O ₂)	Average (mg/m ³ @ 11% O ₂)
Pb	0.00200	0.00563	0.00367	0.00376
Sb	0.00145	0.00378	0.00080	0.00201
Cu	0.00205	0.00427	0.00354	0.00329
Mn	0.00068	0.00118	0.00088	0.00091
V	0.00034	0.00034	0.00032	0.00033
Zn	0.04008	0.04197	0.03548	0.03917
As	0.00232	0.00034	0.00032	0.00099
Cr	0.00019	0.00914	0.00862	0.00598
Co	0.00009	0.00014	0.00008	0.00010
Ni	0.00077	0.02586	0.01784	0.01482
Se	0.00063	0.00131	0.00048	0.00081
Te	0.00068	0.00067	0.00064	0.00067
Tl	0.00051	0.00050	0.00048	0.00050
Cd	0.00032	0.00038	0.00020	0.00030
Hg	0.00006	0.00037	0.00105	0.00049

All data is corrected to standard conditions (S) of 20 °C, 101.325 kPa (dry) unless otherwise noted.

Table 10: Unit 2 - Summary of Operating Data

Parameter		Run 1	Run 2	Run 3	Normal
Test Date - Particulate/Metals		15-Jul-25	16-Jul-25	16-Jul-25	
Test Time - Particulate/Metals		10:33 - 12:35	09:10 - 11:12	11:40 - 13:42	
Boiler Steam Production	(kg/h)	37,132	35,401	35,246	33,724
Percentage of normal	(%)	110%	105%	105%	
Boiler Secondary Combustion Zone Temp	(°C)	905	872	869	929
Percentage of normal	(%)	97%	94%	94%	
Rate of refuse fired	(kg/hr)	11,084	10,567	10,521	10,067
Percentage of normal	(%)	110%	105%	105%	
Rate of aux. fuel fired (Natural Gas)	m ³ /hr	126	0	0	71.5
Percentage of normal (%)	(%)	176%	0%	0%	

*Normal refers to the average operating rate from the previous 30 days

Table 11: Unit 3 Summary of Emission Test Results

Parameter	Run 1	Run 2	Run 3	Average
Test Date - Particulate/Metals	16-Jul-25	17-Jul-25	17-Jul-25	
Test Time - Particulate/Metals	09:55 - 11:57	09:05 - 11:07	11:32 - 13:33	
Duration - Minutes	120	120	120	
Test Date - Acid Gases	17-Jul-25	17-Jul-25	17-Jul-25	
Test Time - Acid Gases	09:27 - 10:27	10:40 - 11:40	11:51 - 12:51	
Duration - Minutes	60	60	60	
Stack Temperature (°C)	156	153	155	155
Average Gas Velocity (m/s)	13.0	12.8	13.2	13.0
Dry Flow Rate (Sm ³ /min)	1088	1118	1138	1115
Moisture (Vol. %)	15.5	12.6	12.9	13.6
Oxygen (Vol. %)(dry basis)	8.73	10.3	10.6	9.9
Carbon Dioxide (Vol. %)(dry basis)	9.63	9.38	8.43	9.14
Particulate (mg/Sm³ @ 11% O₂)	0.29	0.32	1.07	0.56
Hydrogen Fluoride (mg/Sm³ @ 11% O₂)	0.107	0.127	0.133	0.122
Hydrogen Chloride (mg/Sm³ @ 11% O₂)	86.6	102	23.7	70.9
Ammonia (mg/Sm³ @ 11% O₂)	2.36	3.57	5.57	3.83
Nitrous Oxide (mg/Sm³ @ 11% O₂)*	4.32	5.13	8.56	6.00
Total Hydrocarbons (mg/Sm³ @ 11% O₂)	5.47	6.34	6.56	6.12
Trace Metals - Operational Certificate List (mg/Sm³ @ 11% O₂)				
OC Class (Pb, As and Cr)	0.00349	0.01565	0.01842	0.01252
Aluminum (mg/Sm³ @ 11% O₂)	0.00840	0.00452	0.00611	0.00634
Cadmium (mg/Sm³ @ 11% O₂)	0.00008	0.00009	0.00010	0.00009
Lead (mg/Sm³ @ 11% O₂)	0.0013	0.0013	0.0013	0.0013
Mercury (mg/Sm³ @ 11% O₂)	0.00005	0.00005	0.00006	0.00005
Phosphorus (mg/Sm³ @ 11% O₂)	0.00711	0.00094	0.00420	0.00408
Isokinetic Variation (%)	105	101	101	102

All data is corrected to standard conditions (S) of 20 °C, 101.325 kPa (dry) unless otherwise noted.

Table 12: Unit 3 Trace Metals Emissions (OC Class)

Metal	Test 1 (mg/m ³ @ 11% O ₂)	Test 2 (mg/m ³ @ 11% O ₂)	Test 3 (mg/m ³ @ 11% O ₂)	Average (mg/m ³ @ 11% O ₂)
OC Class				
Pb	0.00134	0.00126	0.00132	0.00131
As	0.00032	0.00143	0.00095	0.00090
Cr	0.00183	0.01296	0.01615	0.01031
Sum of OC Class	0.00349	0.01565	0.01842	0.01252
Other				
Al	0.00840	0.00452	0.00611	0.0063
Cd	0.00008	0.00009	0.00010	0.0001
P	0.00711	0.00094	0.00420	0.0041
Hg	0.00005	0.00005	0.00006	0.0000

All data is corrected to standard conditions (S) of 20 °C, 101.325 kPa (dry) unless otherwise noted.

Table 13: Unit 3 Detailed Trace Metals Emissions

Metal	Test 1 (mg/m ³ @ 11% O ₂)	Test 2 (mg/m ³ @ 11% O ₂)	Test 3 (mg/m ³ @ 11% O ₂)	Average (mg/m ³ @ 11% O ₂)
Pb	0.00134	0.00126	0.00132	0.00131
Sb	0.00081	0.00094	0.00095	0.00090
Cu	0.00061	0.00324	0.00282	0.00223
Mn	0.00036	0.00060	0.00318	0.00138
V	0.00032	0.00038	0.00038	0.00036
Zn	0.00720	0.00802	0.01324	0.00949
As	0.00032	0.00143	0.00095	0.00090
Cr	0.00183	0.01296	0.01615	0.01031
Co	0.00008	0.00009	0.00020	0.00013
Ni	0.00129	0.00936	0.03021	0.01362
Se	0.00048	0.00401	0.00792	0.00414
Te	0.00065	0.00234	0.00076	0.00125
Tl	0.00048	0.00056	0.00057	0.00054
Cd	0.00008	0.00009	0.00010	0.00009
Hg	0.00005	0.00005	0.00006	0.00005

All data is corrected to standard conditions (S) of 20 °C, 101.325 kPa (dry) unless otherwise noted.

Table 14: Unit 3 - Summary of Operating Data

Parameter		Run 1	Run 2	Run 3	Normal
Test Date - Particulate/Metals		16-Jul-25	17-Jul-25	17-Jul-25	
Test Time - Particulate/Metals		09:55 - 11:57	09:05 - 11:07	11:32 - 13:33	
Boiler Steam Production	(kg/h)	38,879	35,538	35,559	33,743
Percentage of normal	(%)	115%	105%	105%	
Boiler Secondary Combustion Zone Temp	(°C)	903	927	903	928
Percentage of normal	(%)	97%	100%	97%	
Rate of refuse fired	(kg/hr)	11,606	10,608	10,615	10,072
Percentage of normal	(%)	11500%	105%	105%	
Rate of aux. fuel fired (Natural Gas)	m ³ /hr	170	0	0	125
Percentage of normal (%)	(%)	136%	0%	0%	

*Normal refers to the average operating rate from the previous 30 days

4 DISCUSSION

All Units are in compliance with limits as set out in the OC.

HCl was requested to be performed on all units this survey and quarterly moving forward. There was variability found for this parameter from test to test. Overall, the average HCl concentration isn't considered to be significant and is representative of what would be expected from this type of process.

As stated in Section 2.1, EPA Method 5/29 was modified slightly to accommodate performance based analytical protocols utilized in B.C. for trace metals sampling and analysis. The analytical modification consists of using volumes of recovery reagents different than the method stipulates. In order to validate (ie performance-based QA) the modification, sample Blanks and all samples were made up to the same volume, so that subtraction of the Blank data, was done on equivalent sample sizes. In addition, special Hg spiking of blank filters and peroxide solutions was conducted. This spiking is referred to as a "matrix spike" and is reported in Appendix B, Quality Control for mercury, where the recovery of spiked mercury was calculated to be an acceptable 85 to 115%. It should be noted that independent front half/back half analysis of all trace metals was conducted for this survey. In addition, individual quartz filter blanks were analyzed for each unit.

Sampling was conducted in accordance with their respective reference methods (EPA 29 except as discussed) and passed all appropriate quality assurance and quality control criteria. None of the sample points on any of the three units were outside of the allowable +/- 10% for isokinetic rate.

During the monitoring, there were no environmental observations made that would impact the validity of the test program. The weather was normal with light rain and wind on one day, but otherwise dry. All sampling was conducted/supervised by certified emission testing personnel, using calibrated source sampling equipment and quality-controlled reagents. It is therefore stated that the survey and this report complies with MV's WTEF compliance testing requirements for this third survey in 2025.